


PEMC MARKET ASSESSMENT HIGHLIGHTS

- The average demand and the reserve schedule, recorded at 10,846 MW during the week of 16 - 22 Jan 2023, was higher than the previous week at 10,678 MW and higher than the same week last year at 9,885 MW.
 - The average effective supply during the week was 11,407 MW, higher than the 11,282 MW of the previous week and higher than the 10,381 MW during the same week last year. Ramping limitations were considered in the calculation of the effective supply.
 - The capacity on outage averaged at 4,192 MW, higher than last week's 3,491 MW. About 37% of the 4,192 MW involved Coal plants, while in terms of category, about 52% were Planned Outages.
 - As a result, an average supply margin of 561 MW was observed during the week, which is lower by about 7% relative to the previous week and higher by about 13% in comparison with the same week last year. The thinnest supply margin was 153.14 MW on 16 January 2023 22:05. The average supply margin was 531.64 MW at peak intervals and 583.75 MW at off-peak intervals.
 - Correspondingly, average GWAP was recorded at PHP 7,093/MWh from PHP 5,745/MWh last week. This is lower than the PHP8,135/MWh during the same week last year.
 - No secondary price cap was imposed for this week
 - The top 5 participant groups accounted for about 83% of the offered capacity. The Herfindahl-Hirschman Index (HHI) by participant group indicated partially concentrated and moderately concentrated market based on the offered and registered capacities respectively.
 - The top 5 pivotal plants during the week were –
 1. GNP DINGININ CFTPP (100 % of the time)
 2. STA RITA NGPP (about 85.71% of the time)
 3. SUAL CFTPP (about 56.94% of the time)
 4. MASINLOC CFTPP (about 49.21% of the time)
 5. MARIVELES CFTPP (about 46.88% of the time)
 - Based on the MMS Solution, the top 5 congested equipment during the week were –
 1. 138kV Maasin-Ubay Line 1 (about 45.4% of the time)
 2. 230kV Mexico-Hermosa Line2 (about 3.4% of the time)
 3. 230kV Mexico-Hermosa Line1 (about 2.7% of the time)
 4. 138kV Cebu-Mandaue Line1 (about 2.5% of the time)
 5. 138kV Samboan-Amlan Line1 (about 2.3% of the time)
 - Natural gas and coal plants had lower offered capacity while hydro plants noted slight increase in offer prices during the week.
- IEMOP MARKET SYSTEMS ADVISORY
- No IT-related issue was advised in IEMOP's market systems from 16 - 22 Jan 2023.


SUMMARY (PRICE, SUPPLY, DEMAND AND RESERVE SCHEDULE)

Particulars	16 - 22 Jan 2023	Previous Week (09 - 15 Jan 2023)	Same Week, Previous Year (17 - 23 Jan 2022)	Percent Change From		
				Previous Week	Same Week, Prev Year	
GWAP (PHP/MWh)	max	22,849.89	34,572.79	33,020.51	-33.91%	-30.80%
	min	0.00	-0.99	-8,358.78	100.00%	100.00%
	ave	7,093.25	5,745.11	8,135.22	23.47%	-12.81%
Effective Supply (MW)	max	13,137.40	12,999.06	11,869.74	1.06%	10.68%
	min	9,201.69	9,222.02	8,767.65	-0.22%	4.95%
	ave	11,406.50	11,281.88	10,380.64	1.10%	9.88%
System Demand (MW)	max	11,618.58	11,167.92	10,662.19	4.04%	8.97%
	min	7,829.28	7,144.25	7,162.18	9.59%	9.31%
	ave	9,804.78	9,599.87	9,055.03	2.13%	8.28%
Demand + Reserve Schedule (MW)	max	12,655.72	12,573.42	11,466.96	0.65%	10.37%
	min	8,632.28	8,021.89	7,819.68	7.61%	10.39%
	ave	10,845.70	10,678.03	9,884.51	1.57%	9.72%
Supply Margin (MW)	max	914.80	1,258.68	1,245.36	-27.32%	-26.54%
	min	153.14	54.05	9.24	183.34%	1,557.39%
	ave	560.80	603.85	496.13	-7.13%	13.03%

CAPACITY PROFILE

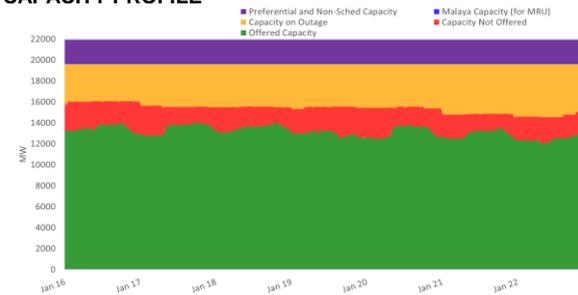


CAPACITY ON OUTAGE BY PLANT TYPE

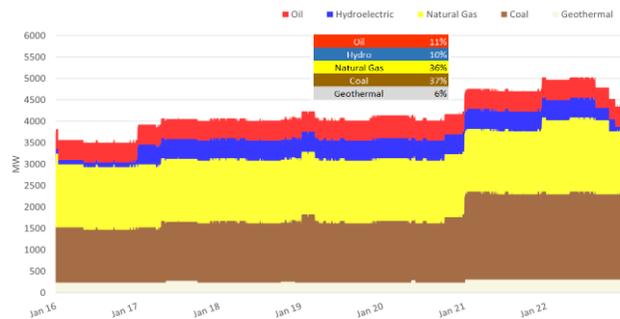

CAPACITY ON OUTAGE BY OUTAGE CATEGORY



RTD CONGESTION






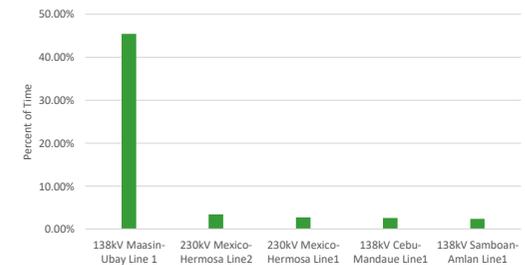


OFFER PATTERN ANALYSIS

Legend

RP: Reference Offer Price – the week of 09-15 Jan 2023 was used as a control for the comparison with the subject price

SP: Subject Offer Price – the week of 16-22 Jan 2023

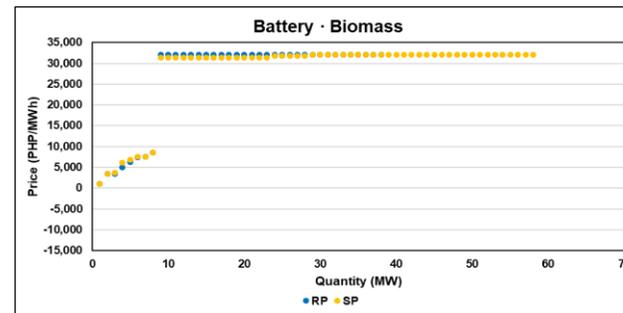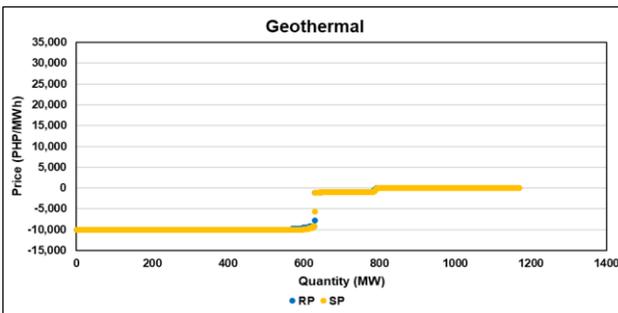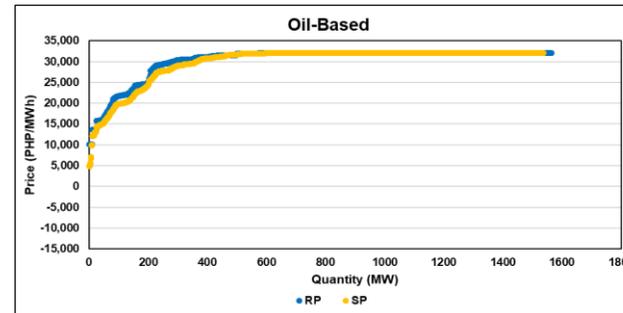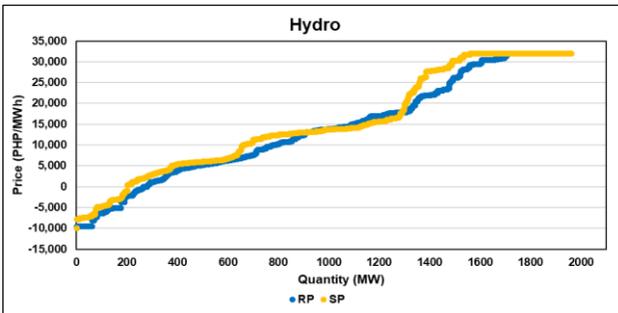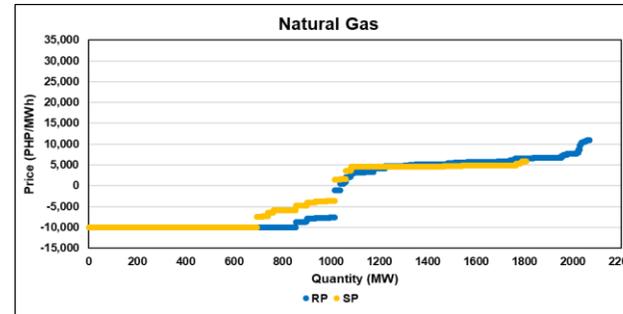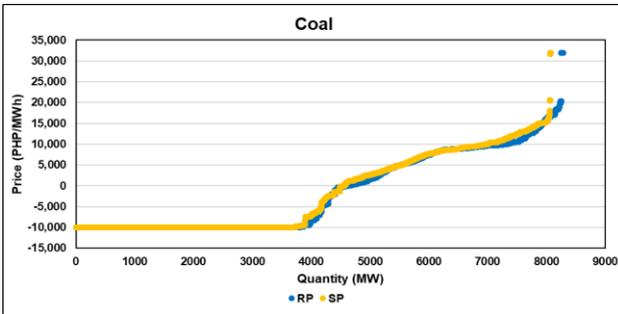

GLOSSARY OF TERMS

EFFECTIVE SUPPLY - The effective supply is equal to the offered capacity of all scheduled generator resources, nominated loading level of non-scheduled generating units and projected output of preferential dispatch generating units, adjusted for any security limit provided by the System Operator and other constraints considered during MMS simulation such as generator offered ramp rates. Scheduled output of plants on testing and commissioning through the imposition of security limit by SO and scheduled output of Malaya plant when it is called to run as Must Run Unit (MRU) are likewise accounted for in the effective supply.

MARKET RESIDUAL SUPPLY INDEX (Market RSI) - The RSI is a dynamic continuous index measured as ratio of the available generation without a generator to the total generation required to supply the demand. The RSI is measured for each generator. The greater the RSI of a generator, the less will be its potential ability to exercise market power and manipulate prices, as there will be sufficient capacity from the other generators. In contrary, the lower the RSI, the greater the market power of a generator (and its potential benefit of exercising market power), as the market is strongly dependent on its availability to be able to fully supply the demand. In particular, a RSI greater than 100% for a generator means that the remaining generators can cover the demand, and in principle that generator cannot manipulate market price. On the other hand, a RSI less than 100% means that the generator is pivotal in supplying the demand.

The RSI for the whole market (Market RSI) is measured as the lowest RSI among all the generators in the market. A Market RSI less than 100% indicates the presence of pivotal generator/s.

PIVOTAL SUPPLIER INDEX (PSI) - The pivotal supplier index is a binary variable (1 for pivotal and 0 for not pivotal) for each generator. The index identifies whether a generator is pivotal in supplying the demand. The PSI is calculated as the percentage of time that a

MARKET SHARE - The fraction of the total capacity or energy that a company or related group owns or controls in the market.

HERFINDAHL-HIRSCHMAN INDEX (HHI) - is a commonly accepted measure of market concentration that takes into account the relative size and distribution of participants in the market. The HHI is a number between 0 and 10,000, which is calculated as the sum of squares of the participant's market share. The HHI approaches zero when the market has very large number of participants with each having a relatively small market share. In contrary, the HHI increases as the number of participants in the market decreases, and the disparity in the market shares among the participants increases. The following are the widely used HHI screening numbers: (1) less than 1,000 - not concentrated; (2) 1,000 to 1,800 - moderately concentrated; (3) greater than 1,800 - concentrated; and (4) greater than 2,500 - highly concentrated.

MAJOR PARTICIPANT GROUP - The grouping of generators by ownership or control.

REGISTERED CAPACITY - The capacity registered by a generator with WESM.

REGISTERED CAPACITY (NET OF OUTAGE) - The capacity registered by a generator with WESM less capacity on outage.

OFFERED CAPACITY - The offer to supply electricity submitted by a generator.

DISCLAIMER: The information contained in this document is based on the available electricity spot market data. The same information is subject to change as updated figures come in. As such, the PEMC does not make any representation or warranty as to the completeness of this information. The PEMC likewise accepts no responsibility or liability whatsoever for any loss or cost incurred by a reader arising from, or in relation to, any conclusion or assumption derived from the information found herein.